


**APA Group**  
 NATURAL GAS EMERGENCY  
 CONTACT NUMBER:  
**Ph. 1300 763 106**

**HAVE YOU ASSESSED THE RISK ASSOCIATED WITH THIS WORK?**  
 REPORT PROMPTLY ANY CONDITION LIKELY TO CAUSE AN ACCIDENT REMEMBER YOU ARE RESPONSIBLE FOR YOUR SAFETY

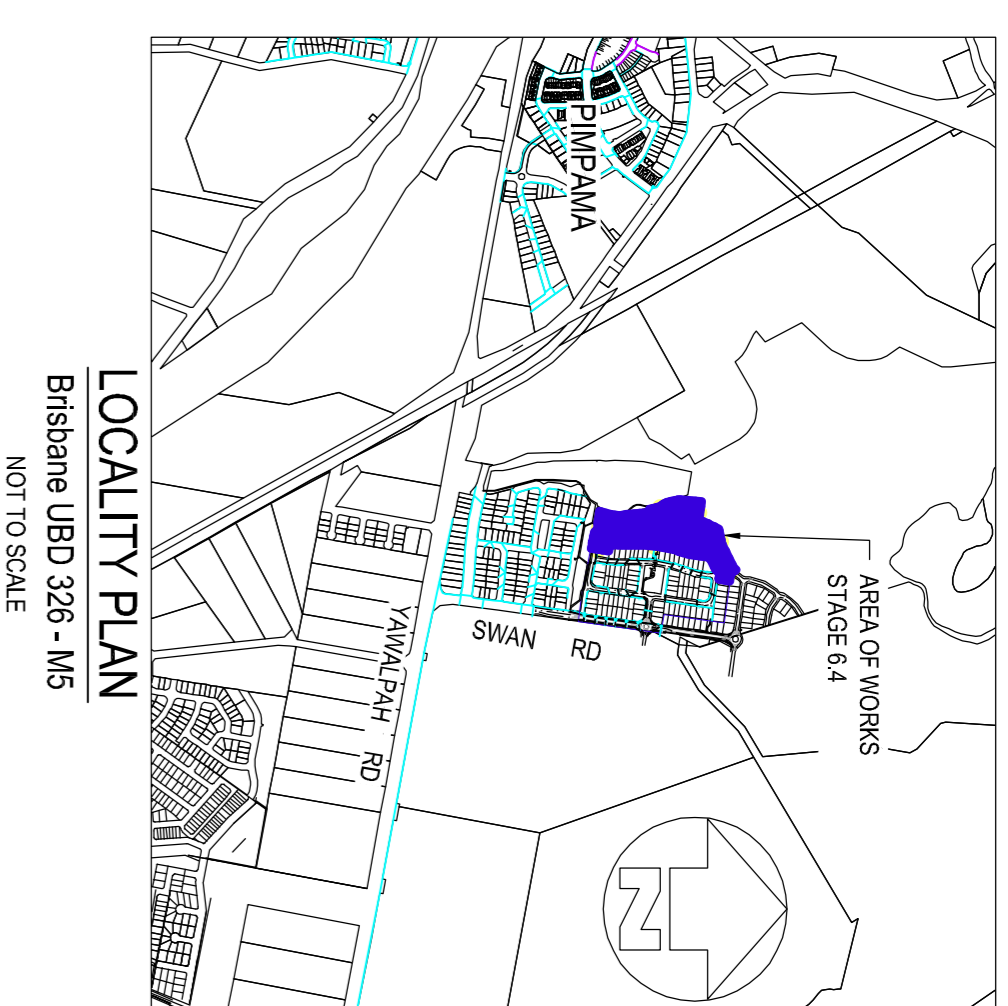

**GAS RETICULATION**

GAS ALIGNMENT FOR MAINS IN STAND ALONE TRENCH 1.05m FROM R.P.B. (REAL PROPERTY BOUNDARY). REFER TO GOLD COAST CITY COUNCIL STANDARD DRAWING - 05-02-005

GAS MAINS WILL BE INSTALLED IN A JOINT-USE TRENCH. THE TRENCH CROSS-SECTION SHALL BE APPROVED BY APA BEFORE CONSTRUCTION.

NB. 300mm CLEARANCE REQUIRED BETWEEN APA GAS MAIN & ALL OTHER CONDUITS. JOINT-USE TRENCH TO EXTEND TO 500mm FROM PROPERTY ALIGNMENT TO ALLOW GAS MAIN TO BE AS FAR AWAY AS POSSIBLE FROM PROPERTY BOUNDARY.

ANY VARIATIONS TO THIS PLAN ARE TO BE APPROVED BY THE RESPONSIBLE APA DESIGN ENGINEER.

CIVIL CONTRACTOR SHALL GIVE APA ONE WEEKS NOTICE BEFORE INSTALLATION OF ROAD CROSSING CONDUITS - EMAIL NOTICE TO [APASched@works@apa.com.au](mailto:APASched@works@apa.com.au)

ELECTRICAL CONTRACTOR SHALL GIVE APA TWO WEEKS NOTICE BEFORE TRENCHING - EMAIL NOTICE TO [APASched@works@apa.com.au](mailto:APASched@works@apa.com.au)

**REFERENCE DRAWINGS**

TRENCH SECTION - CONSTRUCTION - JOINT USE TRENCH - ROAD RESERVE ..... TR-0001/1  
 - FOOTPATH ONLY ..... TR-0001/1  
 GAS GENERAL CONSTRUCTIONS - TRENCHES - PE GAS MAIN - STAND ALONG ..... TR-0003/1  
 GAS SERVICE ALLOCATIONS - GENERAL CONSTRUCTION - CONDUITS & SERVICE CONNECTION TEE - PE GAS MAINS ..... D-0023/1

**CONTACT DETAILS**

PHONE: 0477 398 905  
 EMAIL ADDRESS: [APASched@works@apa.com.au](mailto:APASched@works@apa.com.au)

**LEGEND**

- PROPOSED PE GAS MAINS
- ROAD CROSSING CONDUIT
- PROPOSED STAND ALONE TRENCH
- PROPOSED COMMON TRENCH
- EXISTING HIGH PRESSURE PIPELINE
- PROPOSED END CAP
- PROPOSED REDUCER
- CONNECTION POINT TO EXISTING MAINS

**PIPE LENGTHS**

TOTAL LENGTH - PROPOSED 40PE GAS MAIN - Approx Length - 930 Meters  
 COMMON TRENCH - PROPOSED 40PE GAS MAIN - Approx Length - 870 Meters  
 STAND ALONE TRENCH - PROPOSED 40PE GAS MAIN - Approx Length - 60 Meters  
 NUMBER OF ROAD CROSSINGS - 15 - Approx Length - 230 Meters  
 NUMBER OF LOTS - 49

REVISION INFORMATION		
Revision	Date	Description
0	7/06/14	ISSUE FOR CONSTRUCTION
A	8/04/14	PRELIMINARY ISSUE - NOT FOR CONSTRUCTION

Drawn	JAG	SH	GB	A.P.C
Designed	JAG	SH	SH	
Checked				
Approved				

PROJECT No.:	31397	FILE REF.:	065-10
<b>APA Group</b>		Networks - Queensland	
Allgas Energy Pty Limited		Apt O&M Services (QLD) Pty Ltd	
Apt. 52, 079, 658, 446		Apt. 12, 113, 393, 393	

Date:	8/04/14	Scale:	1:1000 @ A1
Designed:	JAG	Scale:	1:1000 @ A1
Drawn:	JAG	Scale:	1:1000 @ A1
Approved:	A.P.C	Scale:	1:1000 @ A1

**PROPOSED INTERNAL RETICULATION**  
 GAINSBOROUGH GREEN ESTATE  
 STAGE 6.4 - NINGALOO DR, PIMPAMA

DATE PLOTTED: 08 May, 2014 - 8:17am

0 10 20 30 40 50 60 70 80 90 100m  
 1:1000 AT A1  
 1:2000 AT A3